

CHARACTERISTICS STUDY OF ZSI FOR PMSG BASED WIND ENERGY CONVERSION SYSTEMS

M.Sasikumar

Professor, Jeppiaar Engineering College, Chennai, Tamil Nadu, India – 600 119

E-Mail:- pmsasi77@gmail.com

Abstract

This paper deals with a grid power interface system for permanent-magnet synchronous generator (PMSG) based wind power generation system. The proposed system consists of a generator-side buck-type rectifier and a grid-side impedance source inverter, which is employed as a bridge between the generator and the grid. The proposed system components like PMSG, DC Link, impedance network, inverters are modeled by using MAT LAB/SIMULINK. The control strategy for the proposed topology is developed from space-vector modulation and Z-source network operation principles. The unity-power-factor control method is suggested and to establish an optimized control scheme for the generator-side three-switch buck-type rectifier. To extract the maximum power from the wind turbine generator and the power is transferred to the grid system is achieved by adjusting the shoot-through duty cycles of the Z-source network. The performances of the PMSG based WECS has been analyzed and the results are verified.

Keywords: Permanent Magnet Synchronous Generator (PMSG), Wind Energy Conversion Systems (WECS), Impedance Source Inverter (ZSI), Space Vector Modulation Technique (SVM), MATLAB, SIMULINK.

1.Introduction

Wind energy is one of the important sources of renewable energy systems. The potential of wind energy is very large compared to the other non conventional sources. It is non-polluting, safe and the quality of life[4]. The range power output from the wind driven PMSG is mainly depending on the wind velocity flections and load conditions. The increasing infiltration level of wind energy can have a significant impact on the grid, especially under abnormal grid voltage conditions. Thus,

wind generation stations can no longer be considered as a simple energy source. Nowadays, they should provide an operational ability similar to that of conventional power plants. A demanding requirement for wind farms is the fault ride-through capability[11]. According to this demand, the wind turbine is required to survive during grid faults. The ability of a wind turbine to survive for a short duration of voltage dip without tripping is often referred to as the low voltage ride through capability of a turbine. On the other hand, power fluctuation from a turbine due to wind speed variations incurs a deviation of the system frequency from the rated value [5]. Variable-speed wind turbines using a PMSG equipped with full-scale back-to-back converters are very promising and suitable for application in large wind farms. Due to the fact that a multiple pole design can be easily realized in the synchronous generator, it is the only type that provides a realistic opportunity to implement gearless operation, and hence, the features of lightweight and low maintenance can be obtained in this type of wind generation system [12]. In conventional, the PMSG is connected to the grid by means of a fully controlled frequency converter, which consists of a PWM rectifier, an intermediate dc stage, and a inverter. With this configuration, the generator-side converter can completely regulate the generator in terms of speed and electromagnetic torque. This configuration requires more fully controlled switches, which make the system more expensive, particularly for megawatt level applications. Recently, research on three-switch buck-type rectifiers has focused on grid-side current quality improvement and with parallel operation.

2. Block diagram of the proposed system

The block diagram of the proposed system is shown in Fig. 1.1. The PMSG-based generation system is a recent trend in the development of wind generation systems.

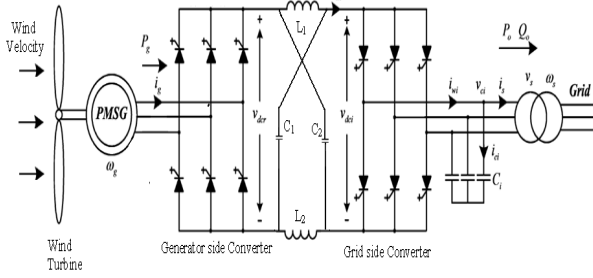


Fig. 1.1 Block diagram of the PMSG based WECS

Traditionally, there are two types of inverters that are being used, commonly known as voltage-source inverter (VSI) and current-source inverter (CSI). Both of these inverters have a limited operating range, even though both are widely used in DG applications [3]. To overcome the limited operating range, these inverters need to be connected with a separate dc–dc converter stage in the front end. This enables them to operate in both buck and boost modes. In traditional inverters, the upper and lower switches of each phase cannot be switched on simultaneously either by EMI noise. The output voltage of the ZSI is limited to either greater or lesser than the given input voltage[8]. The variable output voltage from the induction generator is rectified and then inverted by using the proposed inverter. The ZSI can produce an output voltage greater than the input voltage by controlling the shoot through time T_o . This proposed scheme is used to improve the power factor and reduce harmonic current [1].

4. Control technique:

The control strategy for the generator-side converter (the three-switch buck-type rectifier) is discussed based on the equivalent circuit and phasor diagram of the PMSG as shown. The machine terminal voltage serves as the input voltage to the rectifier, termed as V_{in} , which is

equal to the machine back EMF E_s minus the voltage drop in the machine impedance $(R_s + jX_s)$. From the equivalent circuit, the steady state equation of the PMSG can be expressed as,

$$\begin{bmatrix} V_{sd} \\ V_{sq} \end{bmatrix} = \begin{bmatrix} R_s & -p\omega_r L_{sq} \\ p\omega_r L_{sd} & R_s \end{bmatrix} \cdot \begin{bmatrix} I_{sd} \\ I_{sq} \end{bmatrix} + \begin{bmatrix} 0 \\ p\omega_r \lambda_{pm} \end{bmatrix} \quad (1.1)$$

Where,

R_s , L_{sd} , and L_{sq} are the PMSG stator resistance and the direct- and quadrature-axis inductances, respectively.

ω_r is the generator speed, p is the PMSG pole pairs, and

$\lambda_{pm} = L_{pm} I_{pm}$ is the permanent magnetic flux.

3. Unity power factor control

The angle ϕ_i between the PMSG terminal voltage and the generator stator current is equal to the input power-factor angle of the three-switch buck rectifier, assuming small capacitance of the filter[2]. The unity-power-factor control of the rectifier can be implemented by making the stator current vector follow the measured terminal voltage vector. That means that the angle ϕ_i is kept at zero, meaning that the rectifier can be treated as an equivalent —resistance, load of the PMSG. Thereby, the generator current harmonics can be reduced, and the generator efficiency can be improved compared to the conventional diode–rectifier topology, where the sinusoidal generator current cannot be achieved. With unity-power-factor control, the overall volt–ampere of the front-end rectifier would contribute to the active power transfer and thereby reduce the power rating of the proposed configuration [6]. This would lead to a smaller size and hence reduce the cost of the power circuit, which is one of the significant considerations for megawatt-level wind turbine design.

5. Space vector modulation (SVPWM):

The basic topology of the three-phase two-level voltage-fed inverter is expressed in Fig. 5.1(a), while Fig. 5.1(b) shows its eight switching states of which six $[U_1 (100) - U_6 (011)]$ are

Active state vectors to form a hexagon, and two $[U_0 (000)]$ and $[U_7 (111)]$ are zero state vectors that lie at the origin, that is noted by the command voltage vector U_c in sector 1.

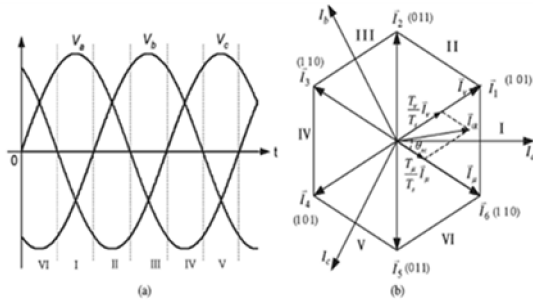


Fig 5.1 (a) Supply Voltage (b) Switching states of the inverter

The operation in under-modulation range is determined by the modulation index M , which is defined as the ratio between the magnitude of the command or reference voltage vector and the peak value of the fundamental component of the square-wave voltage[10]. The modulation index (M) varies between 0 and 1 and the under-modulation region ($0 \leq M < 0.907$). The reference voltage vector remains within the hexagon [9]. The over-modulation region is subdivided into two modes: mode I [$0.907 \leq M < 0.952$] and mode II [$0.952 \leq M \leq 1.00$].

6. Results and discussion

In the proposed method instead of the PWM, SVPWM is used and for rectifier three switch buck rectifier is used. The space vector model is done separately by calculating the vector states of the switches for both the rectifier and inverter with the help of the space vector calculation in the report and also from the reference papers. With the above references the model is simulated and the simulation results are given below. As the project is intended to the new modal in WECS the harmonics are not considered here. The simulink model of the proposed system is shown in fig. 6.1.

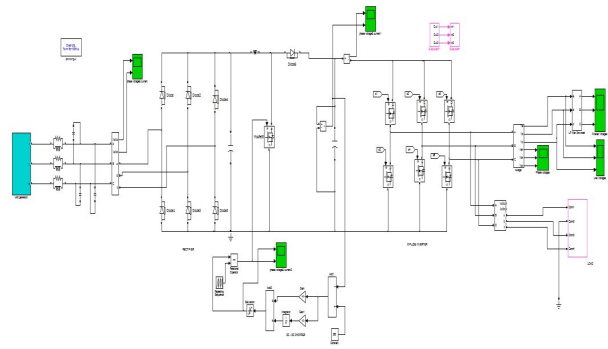


Fig.6.1 Simulation of PMSG with Chopper Based WECS Using SVPWM

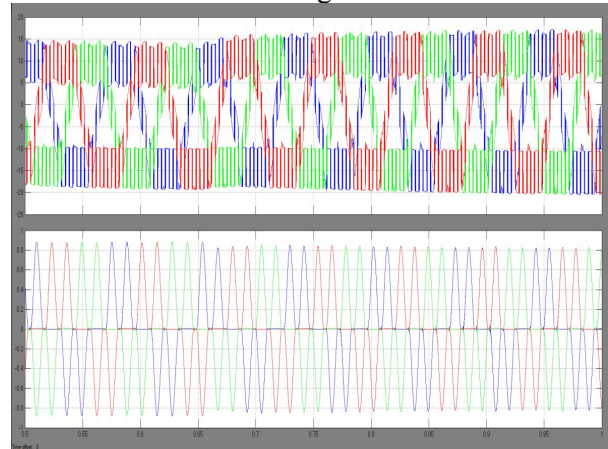


Fig. 6.2 Output phase voltages of wind generating system

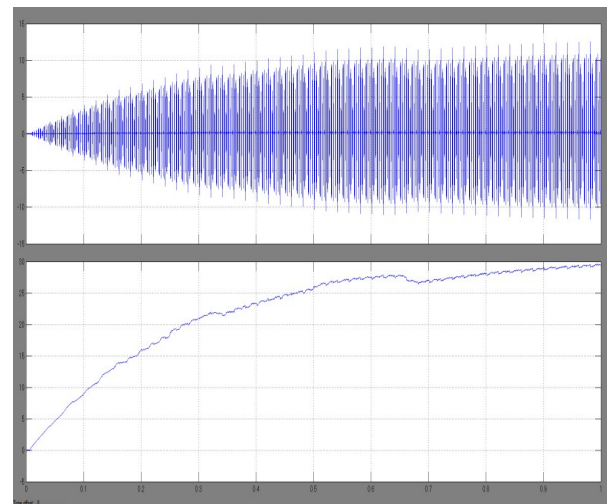


Fig. 6.3 Output current and the voltage waveform of buck rectifier

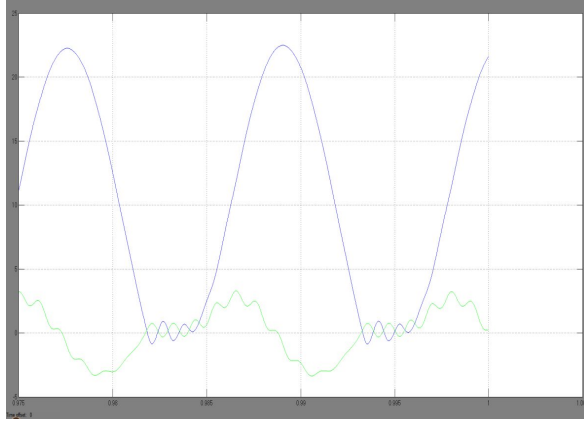


Fig. 6.4 Active and reactive power output of the system

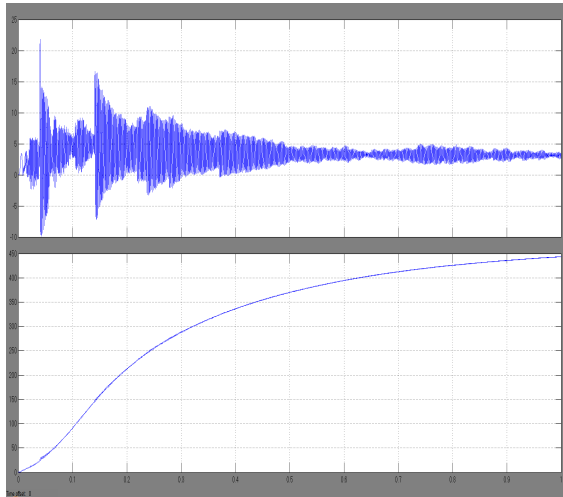


Fig 6.5 Output voltage of the Buck rectifier

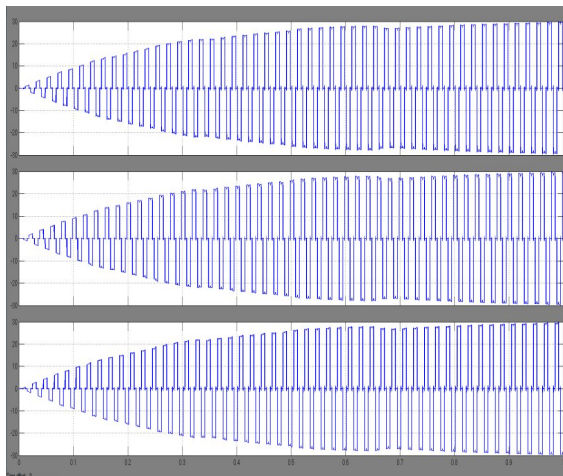


Fig. 6.6 Line output voltages of the system.

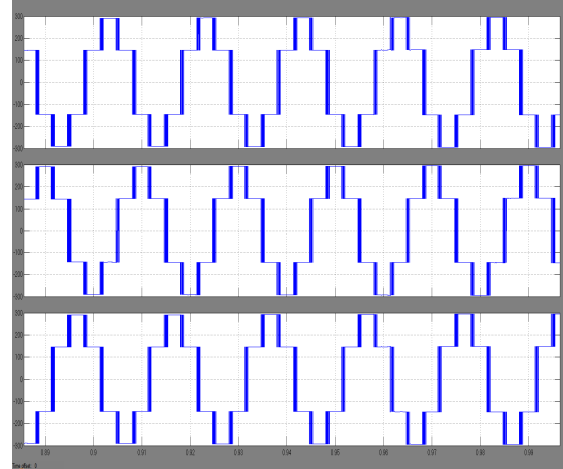


Fig. 6.7Phase output voltage of the system

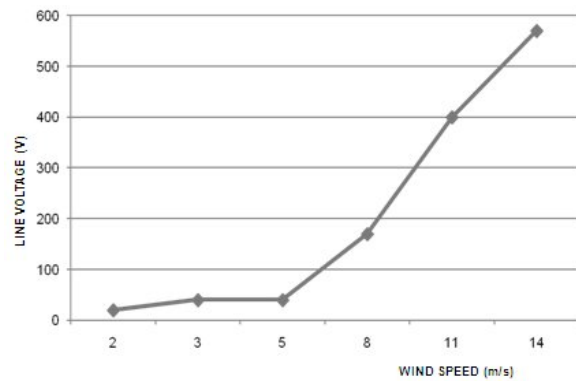


Fig 6.8 Comparative analysis chart of Line voltage with change in wind velocities

The output voltage of the wind driven PMSG can be evaluated at the wind velocity of 3 m/s. The PMSG rating is taken as 10 Nm, 300 V_{dc}, 2000 RPM and the torque is given as input to PMSG from the wind turbine. The leakage flux of wind generator along with the LC filter, used at PMSG output side to protect harmonics injected into the generating system. The obtained PMSG output voltage as 20 V. The phase voltage waveform of the wind driven PMSG is shown in fig. 6.1. The phase voltage of the system is shown in fig 6.2. The output current and voltage of the buck rectifier is shown in fig. 6.3& 6.5. The real and reactive power of the system is shown in fig. 6.4. The line voltage and phase voltage waveforms are shown in fig 6.6 and 6.7 respectively. The line voltage variations for the varying wind velocity conditions are tabulated in fig 6.8.

7. Conclusion

The simulation results of a buck-type rectifier on the generator side and grid-side Z-source-inverter-based wind generation system have been discussed. The control algorithms of the proposed system have been developed from Z-source network and SVM principles. The proposed control stagey approach has been optimized from the fundamentals of the $I_d = 0$ control and unity-power-factor method. In these proposed system, Z-source inverter to decouple the active- and reactive-power control while extracting the maximum wind power by adjusting the shoot through duration of the Z-source network. Instead of only synchronization of SVM, if we took the output compared with the buck rectifier and inverter, the efficiency and effective output may increase.

References

1. Z. Chen, J. M. Guerrero, and F. Blaabjerg, "A review of the state of the art of power electronics for wind turbines," *IEEE Transactions of Power Electronics*, vol. 24, no. 8, Aug. 2009, pp. 1859–1875.
2. J. M. Carrasco, L. G. Franquelo, J. T. Bialasiewicz, E. Galvan, R. C. P. Guisado, A. M. Prats, J. I. Leon, and N. Moreno-Alfonso, "Power electronic systems for the grid integration of renewable energy sources: A survey," *IEEE Transactions of Industrial Electronics*, vol. 53, no. 4, Aug. 2006, pp. 1002–1016.
3. H. Polinder, F. F. A. Vander Pijl, G. J. De Vilder, and P. J. Tavner, "Comparison of direct-drive and geared generator concepts for wind turbines," *IEEE Trans. Energy Convers.*, vol. 21, no. 3, Sep. 2006, pp. 725–733.
4. A. Mirecki, X. Roboam, and F. Richardeau, "Architecture complexity and energy efficiency of small wind turbines," *IEEE Transactions of Industrial Electronics*, vol. 54, no. 1, Feb. 2007, pp. 660–670.
5. P. Rodriguez, A. V. Timbus, R. Teodorescu, M. Liserre, and F. Blaabjerg, "Flexible active power control of distributed power generation systems during grid faults," *IEEE Transactions of Industrial Electronics*, vol. 54, no. 5, Oct. 2007, pp. 2583–2592.
6. J. F. Conroy and R. Watson, "Low-voltage ride-through of a full converter wind turbine with permanent magnet generator," *IET Renewable Power Generation*, vol. 1, no. 3, Sep. 2007, pp. 182–189.
7. J. Y. Dai, D. D. Xu, and B. Wu, "A novel control scheme for current source- converter-based PMSG wind energy conversion systems," *IEEE Transactions of Power Electronics*, vol. 24, no. 4, Apr. 2009, pp. 963–972.
8. M. Malinowski, S. Stynski, W. Kolomyjski, and M. P. Kazmierkowski, "Control of three-level PWM converter applied to variable-speed-type turbines," *IEEE Transactions of Industrial Electronics*, vol. 56, no. 1, Apr. 2009, Jan 2009, pp. 69–77.
9. S. Nishikata and F. Tatsuta, "A new interconnecting method for wind turbine/generators in a wind farm and basic performances of the integrated system," *IEEE Transactions of Industrial Electronics*, vol. 57, no. 2, Feb. 2010, pp. 468–475.
10. S. Grabic, N. Celanovic, and V. A. Katic, "Permanent magnet synchronous generator cascade for wind turbine application," *IEEE Transactions of Power Electronics*, vol. 23, no. 3, May 2008, pp. 1136–1142.
11. M. Chinchilla, S. Arnaltes, and J. C. Burgos, "Control of permanent magnet generators applied to variable-speed wind-energy systems connected to the grid," *IEEE Transactions of Energy Conversion*, vol. 21, no. 1, Mar. 2006, pp. 130–135.
12. J. A. Sayago, T. Bruckner, and S. Bernet, "How to select the system voltage of MV drives - A comparison of semiconductor expenses," *IEEE Transactions of Industrial Electronics*, vol. 55, no. 9, pp. 2008, 3381–3390.
13. T. Nussbaumer, M. Baumann, and J.W. Kolar, "Comprehensive design of a three-phase three-switch buck-type PWM rectifier," *IEEE Transactions of Power Electronics*, vol. 22, no. 2, Mar. 2007, pp. 551–562.



Dr. M. Sasikumar has received the B.E degree in Electrical and Electronics Engineering from K.S.Rangasamy College of Technology, Madras University, India in 1999, and the M.Tech degree in power electronics from VIT University, in 2006. He has obtained his Ph.d. degree from Sathyabama University, Chennai. . Currently he is working as a Professor and Head in Jeppiaar Engineering College, Chennai Tamilnadu, India. He has published papers in national, international conferences and journals in the field of power electronics and wind energy conversion systems. His area of interest includes in the fields of wind energy systems and power converter with soft switching PWM schemes. He is a life member of ISTE.